

New Construction - Minimum Clearance for Gas Meter Installation

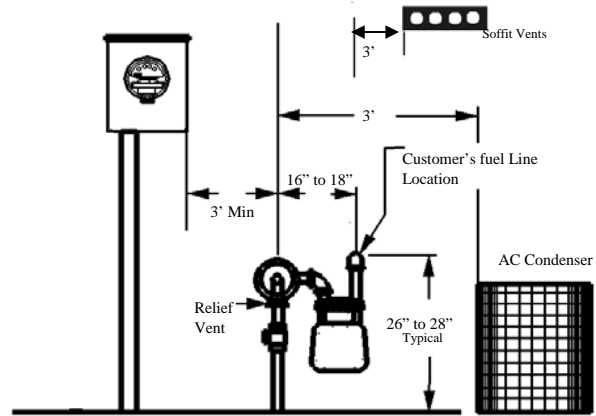
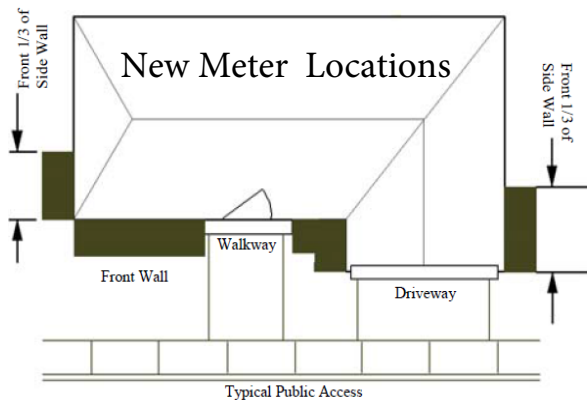


Diagram A

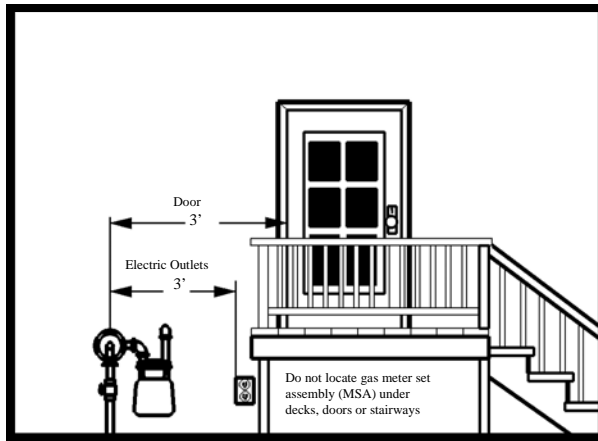


Diagram B

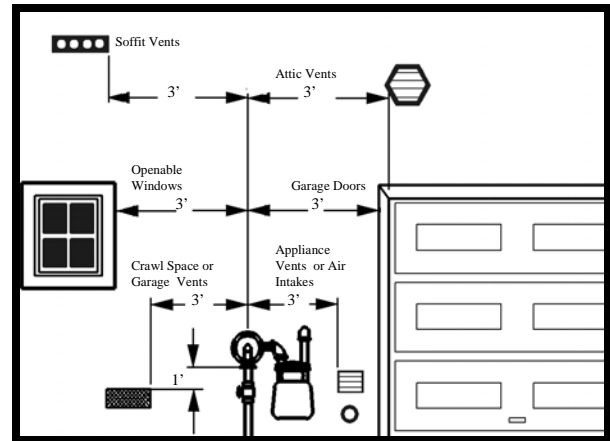


Diagram C

Gas meter minimum clearance requirements from the relief vent

Building Feature	Horizontal	Under	Above	Diagram	
Appliance Combustion Air Intake	3 feet *	Not Permitted		B	*3 feet minimum or greater as specified by the appliance manufacturer
Appliance Vents	3 feet	Not Permitted		C	
Attic Vents	3 feet	Not Permitted		A, B	
Crawl Space Vents / Garage Vents	3 feet	Not Permitted		B	** can be closer if separated by a wall, contact NMGC for specifications
Doors / Garage Doors	3 feet	Not Permitted		A, B	
Electric Meters	3 feet	Not Permitted		A	
Roof Canale (Drain)	12"	Not Permitted			
Electric Outlet	3 feet	Not Permitted	3 feet	B	
Return Air Intake/ Swamp Cooler	10 feet **	Not Permitted		B	
Soffit Vents (single story)		3 feet	Not Permitted	A,C	
Operable Windows (Includes 2 nd story)		3 feet		B	
AC Condenser	3 feet	Not Permitted		A	
Any Ignition Source	3 feet	Not Permitted	Not Permitted		